


\\woodardclarmann.net\shared\Projects\RM\CS\SF\002-007 SFPUC WW CS-955BIB, Task Order\TO 10 - Sewer Laterals Program Phase 1B, Project Work\Task- Revised Standards and Details Completion\Final Submittal\CAD\RevisedSewer Config Figures.dwg

NOTES:

1. ALL PLUGS SHALL BE CONCRETE OR BRICK AND MORTAR.
2. SEWER LATERALS LARGER THAN 12" IN DIAMETER SHALL BE PLUGGED AND FILLED WITH SLURRY AS SPECIFIED IN SFPW STANDARD SPECIFICATIONS CHAPTER 3.
3. SEWER LATERALS SMALLER THAN 12" IN DIAMETER SHALL BE PLUGGED AS SPECIFIED IN SFPW STANDARD SPECIFICATIONS CHAPTER 3.
4. PLUG SEWER LATERAL AT LOCATIONS "A", "B", "C", AND "D".

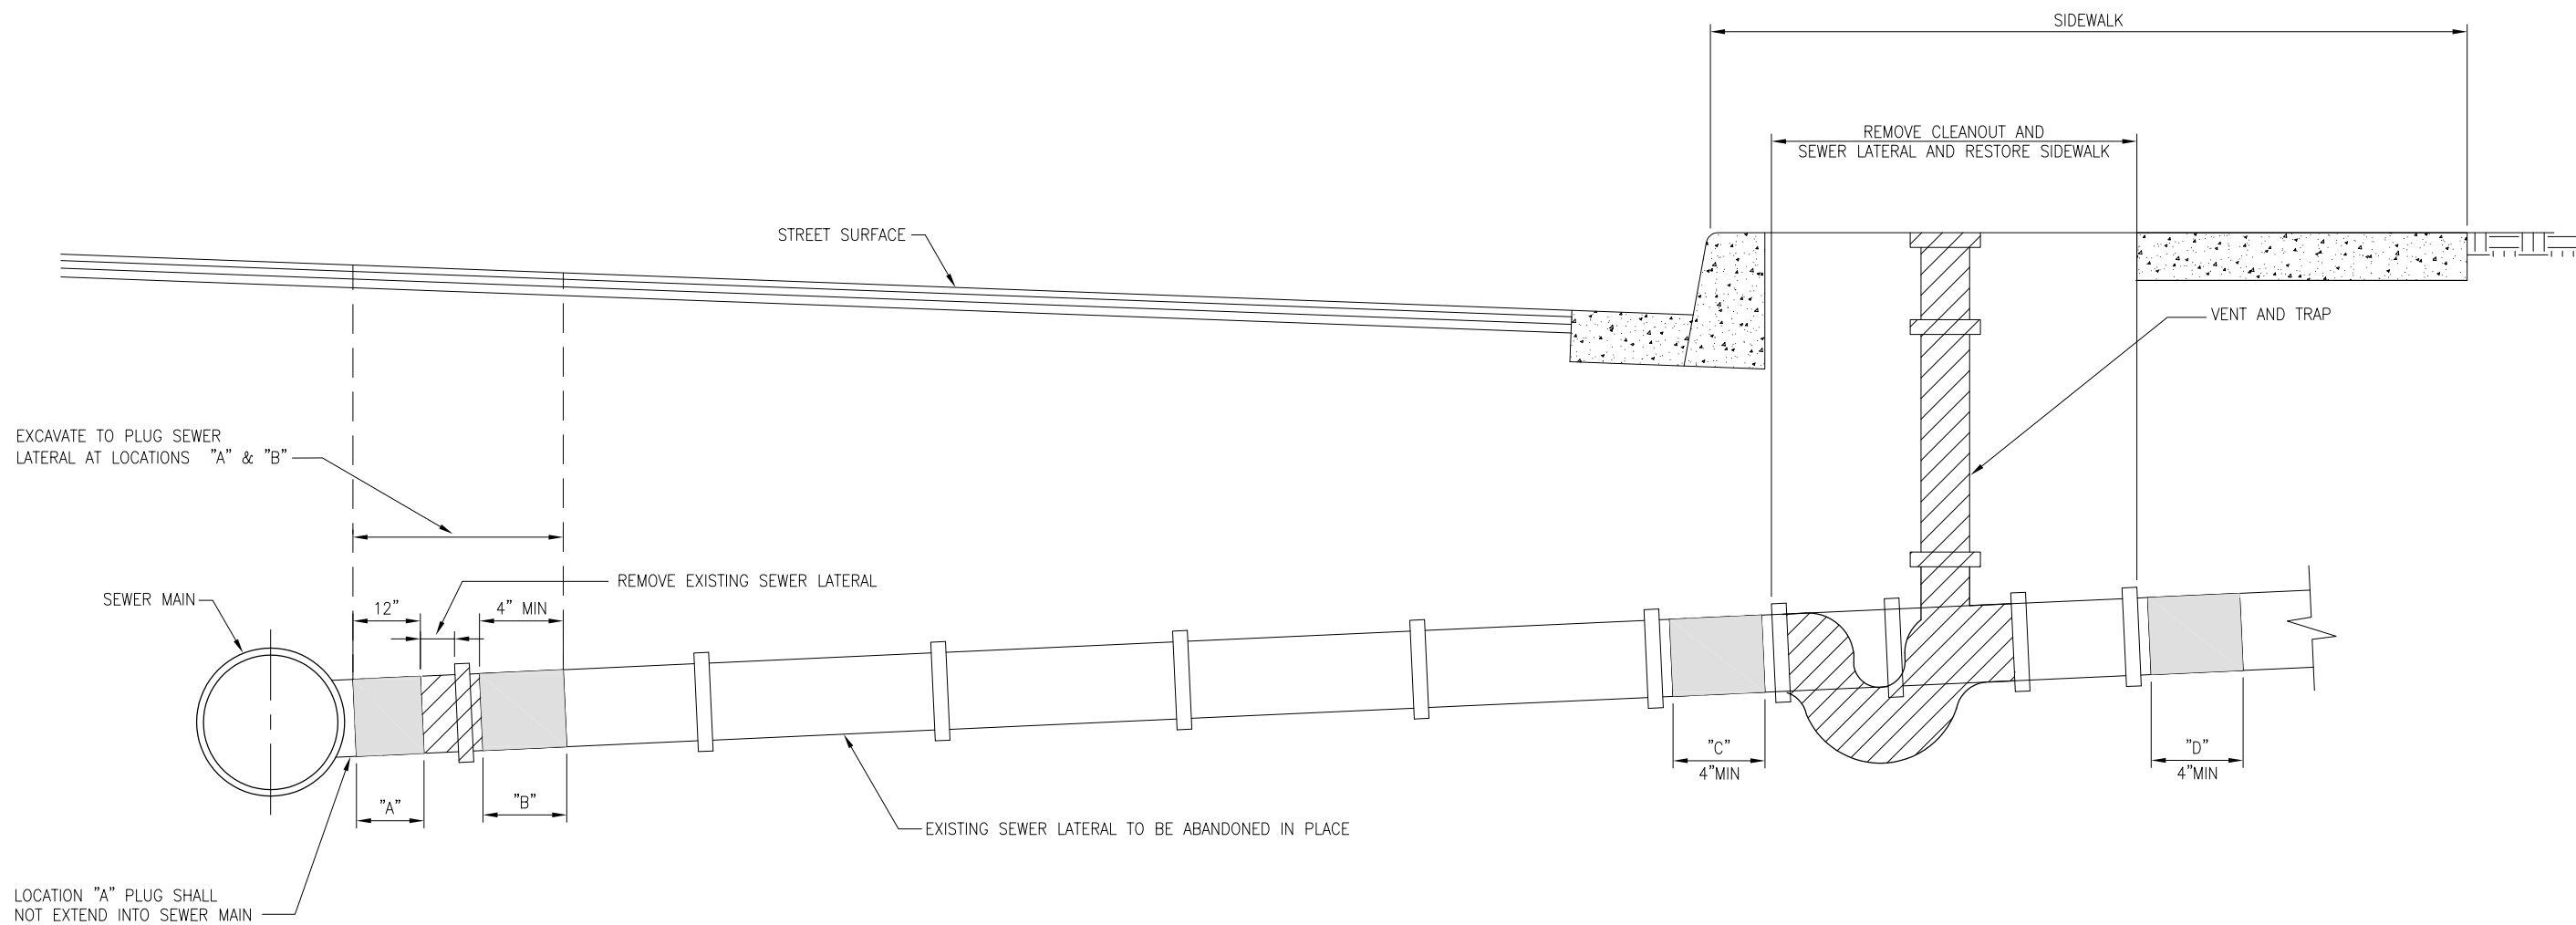

APPLICABLE TO BOTH
COMBINED AND SANITARY
SEWER SYSTEMS



**SEWER LATERAL
STANDARD DETAILS**
SAN FRANCISCO PUBLIC UTILITIES COMMISSION

DATE
MAY 2017

REVISION
1.0

REVISED

SEWER LATERAL ABANDONMENT

DWG NO.

19